



Tight Fit

Gas Tight Joint II




Fire-free copper tube connector
Designed for all HVAC equipment
Compatible with most air-conditioning installation

TIGHT FIT

Daikin Tightfit is a non-brazed connection suitable for piping. Pipes can be joined easily and quickly without brazing or using any special tools. It meets stringent safety requirements and provides leak-free tightness among various substantial benefits.

- ▶ Double edged claw catches the pipe to form tight mechanical sealing
 - ▶ 3 types of connectors suitable for most pipe sizes and applications
 - ▶ Unique mechanical and resin sealings prevent gas leak completely.
- It is durable up to 4 times (17.2MPa) of max. operating pressure

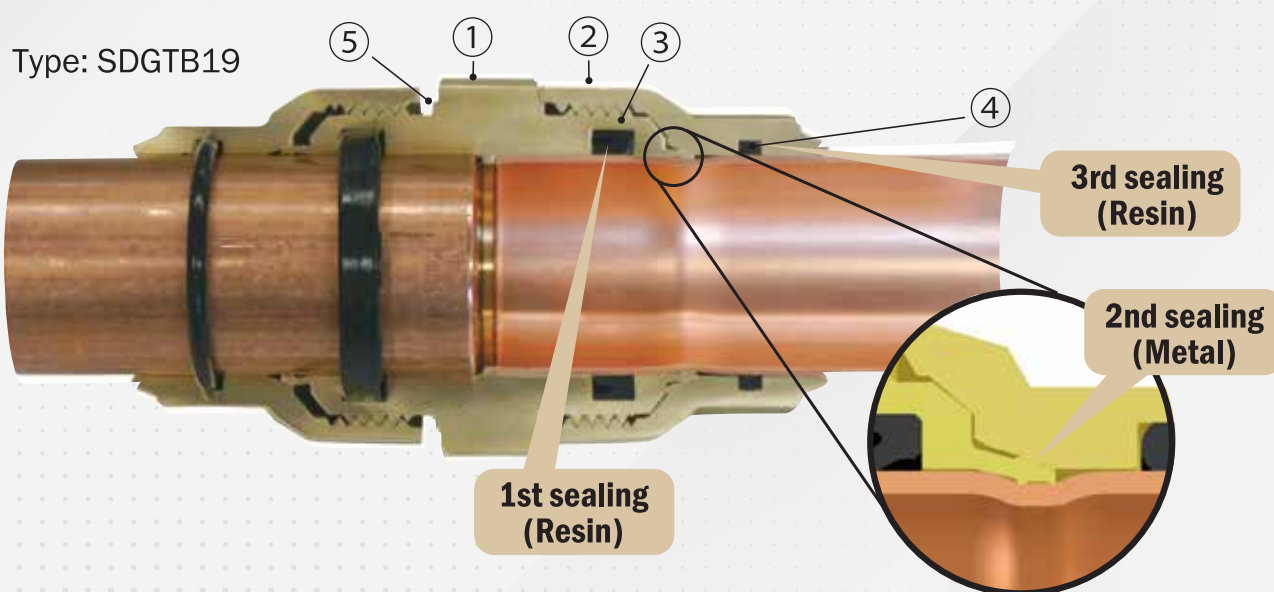

Legend

Name	Material	Remark
① Main body	C3771	Forged and Machined Brass
② Nut	C3771	Forged and Machined Brass
③ Gasket	IIR	Main sealing
④ O-ring	EPDM	Secondary sealing & moisture stopper
⑤ Indicator	Luminous marker	Green color

Technical specifications

Applications	Refrigeration / Air-conditioning / Heat Pump (Refrigeration side) / VRV
Applicable fluid	
Refrigerant	R410A, R32
Refrigeration oil	Ether oil / Ester oil / Polyalkylene glycol oil
Max. pressure [^]	4.3 MPa
Min. pressure [^]	-0.101MPa (-755 mmHg)
Max. Temp.*	130°C
Min. Temp.*	-45°C
Pressure Resistance	17.2MPa x 2 min.
Applicable copper pipe	
ASTM B280-08, B88-09 (Type L), EN12735	
Size	Φ6.4 - Φ41.8
Thickness	0.8mm-2.0mm
Type	O(∼Φ15.9) & H(Φ19.1∼)
Form	Coiled tube & Straight pipe
Electrical Continuity	Maintains earth continuity without the need for additional earth continuity straps Approved Connection: Copper to Copper

[^] Operating Pressure: -0.101MPa(-755mmHg) – 4.3MPa

* Operating Temperature: -45°C – 130°C

Quality & Safety Standards

According to ISO14903	
Type of Joints	Hermetically sealed joints ※ Under size 28 Permanent joints ※ Above size 34
Tightness test	ISO14903-17,7.4 (Level A1) ※ Under size 28
Pressure-temperature vibration tests (PVT)	ISO14903-17,7.6
Operation simulation	ISO14903-17,7.7
Freezing test	ISO14903-17,7.8
Additional pressure test for hermetically sealed joints	ISO14903-17,7.9
Vacuum test	ISO14903-17,7.10
Compatibility screening test	ISO14903-17,7.11
Fatigue test for hermetically sealed joints	ISO14903-17,7.12
Additional tightness test	
Bending test ①	Pressurized by 0.5MPa air with 15° bending angle
Bending test ②	Pressurized by 3.3MPa N ² with ±10mm displacement on 1m span
Torsion test	90° torsion angle
Maximum squeeze torque	14~49Nm ※ Under size 28 (according to the size)
Expected life	

The expected life of the O-ring, if used within the product specifications for temperature and pressure, is at least 30 years.

Tightfit is a registered trademark of Daikin in Asia and numerous countries worldwide, and is a product of superior performance and quality.


Quality Assurance



- ▶ Guaranteed to be tight and leak-free
- ▶ Reliable and secure with no brazing required
- ▶ Conforms to ISO14903
 - Tightness test: $P=4.3\text{MPa}$;
Test medium: 100% Helium, $T=22^{\circ}\text{C}$
Max leakage: $7.5 \times 10^{-7} \text{ Pa} \cdot \text{m}^3/\text{s}$ or less.
 - Vacuum test: 6.5kPa in absolute

System Reliability

- ▶ No risk of copper oxide or soot in pipes due to no brazing
- ▶ Prevents early compressor failure and prolongs the lifespan of air-conditioners



Safety First



- ▶ As no brazing is required, fire hazards are completely eliminated during installation on site
- ▶ No risk of handling high pressure and flammable gas

Easy Installation

- ▶ No need to prepare heavy and expensive brazing tools or hire specialized technicians
- ▶ Easy for anyone to install by using a simple torque tightening method, now made easier with lower torque



**LOW
TORQUE**

Current model (Type: BDGTA19)

45Nm

30% less

30Nm

New model (Type: SDGTB19)

Time & Costs Savings



- ▶ No need to apply for hot work permit or station fire safety watchers onsite, thus saving time and cost with less administrative work
- ▶ Simple installation process also reduces installation time

Simple 4-Step Action

Preparation

Chamfering of the pipe outside and inside

Half of pipe thickness
chamfering is recommended


Copper Pipe

Step 1

Marking the insertion standard line

Marking method : using marking gauge

Mark the insertion "T" or "L" standard line with the marking gauge and marker pen at proper position of each pipe size.




Step 2

Pipe insertion

- 1) Insert firmly by hand until the pipe stops.
- 2) Make sure that the insertion standard line is no longer visible.


- Do not tighten the nut before pipe insertion.
- When inserting the pipe, do not apply excessive force. The O-ring will be damaged.



Step 3

Manual tightening of nut


Hold the main body and tighten the nut in the direction of the arrow by hand until it will not turn anymore.



Step 4

Tightening of nut


Hold the main body and tighten the nut with a monkey wrench in the direction of arrow until the green indicator disappears and the nut comes into contact with the flat face of the body.





Check

1. Green indicator should be hidden.
2. Place the marking gauge on the end face of the nut and make sure that the "T" or "L" shaped mark falls completely within the notch in the marking gauge.


The marking gauge contains one notch for measuring the insertion of pipe of $\varnothing 28$ or less, and another notch for measuring the insertion of pipe of $\varnothing 31$ or more. Be sure you are using the correct notch when measuring.



Green indicator is hidden.



"L" shaped mark falls within the notch



If the "T" or "L" shaped mark falls outside the notch in the marking gauge, cut off the joint, replace it with a new joint, and carry out construction again.

Full line-up

Standard Joint



Asymmetry Joint

NEW 90° Bend Joint




NEW Test Plug



Size	Model name	Size	Model name	Size	Model name	Size	Model name
Φ 6.35	SDGTB06	Φ 9.52-6.35	SDGTB0906	-	-	Φ 6.35	SDGTKB06
Φ 9.52	SDGTB09	Φ 12.70-9.52	SDGTB1209	-	-	Φ 9.52	SDGTKB09
Φ 12.70	SDGTB12	Φ 15.88-12.70	SDGTB1512	-	-	Φ 12.70	SDGTKB12
Φ 15.88	SDGTB15	Φ 19.05-15.88	SDGTB1915	-	-	Φ 15.88	SDGTKB15
Φ 19.05	SDGTB19	Φ 22.22-19.05	SDGTB2219	-	-	Φ 19.05	SDGTKB19
Φ 22.22	SDGTB22	Φ 25.40-22.22	SDGTB2522	Φ 22.22	SDGTLB22	Φ 22.22	SDGTKB22
Φ 28.58	SDGTB28	Φ 28.58-25.40	SDGTB2825	Φ 28.58	SDGTLB28	Φ 28.58	SDGTKB28
Φ 34.92	BDGTA34	Φ 34.92-28.58	SDGTB3428	-	-	-	-
Φ 41.28	BDGTA41	-	-	-	-	-	-


Dimension & Weight

Standard Joint

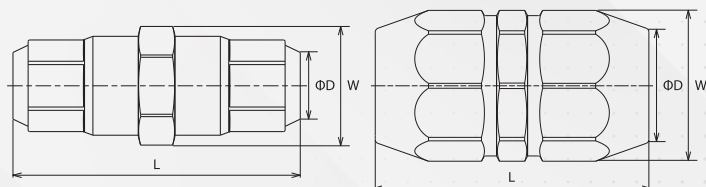


Size	L (mm)	W (mm)	Weight (g)
Φ 6.35	50.4	15.0	43.0
Φ 9.52	55.0	19.9	79.0
Φ 12.70	59.0	23.5	113.0
Φ 15.88	74.0	30.0	210.0
Φ 19.05	76.8	34.6	273.0
Φ 22.22	83.4	40.2	292.0
Φ 28.58	88.0	46.7	515.0
Φ 34.92	101.5	51.1	686.0
Φ 41.28	103.5	58.3	881.0

Asymmetry Joint

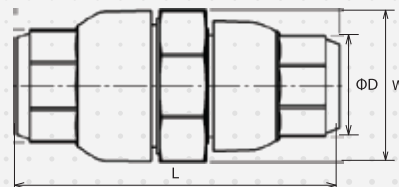

Size	L (mm)	W (mm)	Weight (g)
Φ 9.52-Φ 6.35	52.7	19.9	67.0
Φ 12.70-Φ 9.52	57.5	23.5	101.0
Φ 15.88-Φ 12.70	65.0	30.0	164.0
Φ 19.05-Φ 15.88	76.8	34.6	244.0
Φ 22.22-Φ 19.05	81.5	40.2	358.0
Φ 25.40-Φ 22.22	85.8	43.5	444.0
Φ 28.58-Φ 25.40	88.1	46.7	505.0
Φ 34.92-Φ 28.58	101.5	51.1	645.0




NEW

90° Bend Joint

Size	L (mm)	Weight (g)
Φ 22.22	120.0	655.7
Φ 28.58	145.0	968.4

NEW


Test Plug



Size	L (mm)	W (mm)	Weight (g)
Φ 6.35	43.0	15.0	53.0
Φ 9.52	44.0	20.0	67.6
Φ 12.70	46.0	23.0	73.4
Φ 15.88	50.0	30.0	96.6
Φ 19.05	52.0	34.0	111.7
Φ 22.22	54.0	40.0	135.6
Φ 28.58	54.0	46.0	146.0

Project References

Suitable for all HVAC equipment, Tightfit is perfect for a variety of applications. Most projects cite cost and time savings as a key benefit to using Tightfit, in addition to a safe and easy installation process.

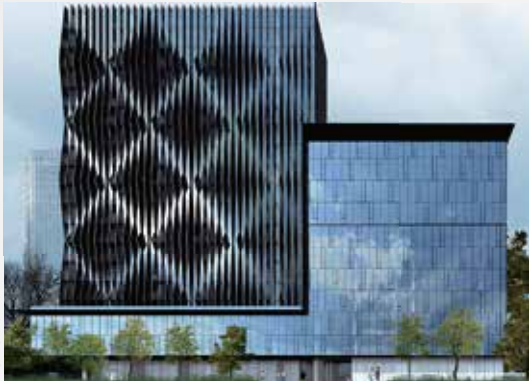

OFFICES

Nueva Córdova's Building (Chile)
Twin Engine, Pune (India)
Vasanth & Co, Chennai (India)

RESIDENCES

Ruparel Ariana, Mumbai (India)
BW Residential Building (Brazil)
MANSÃO BAHIANA DE TENIS (Brazil)
Residência Samuel Locks (Brazil)
Villa 91 Vinhomes Central Park (Vietnam)
Villa - My Tho (Vietnam)
Vineet Bhatt Residence, Delhi (India)
Trump Tower (Philippines)
Ofcina Laboratorio Casasco (Argentina)

RENOVATION

Concessionaire Toyota Ferro (Argentina)
Toyota Panamericana (Argentina)
Great Eastern Street Hotel (United Kingdom)
INTER-WA HOME OFFICE (Thailand)
Yue Hwa Building (Singapore)
Umeda Center Building (Japan)



HOTELS

St. Regis Bermuda Hotel (Bermuda)





The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin MEA. Daikin MEA has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin MEA explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin MEA.

DAIKIN MIDDLE EAST AND AFRICA FZE

P.O. Box 18674, Plot MO0426, JAFZA North, Jebel Ali Free Zone, Dubai, UAE | Tel: +971 (0) 4 815 9300 | Fax: +971 (0) 4 815 9311

E-mail: info@daikinmea.com Web: www.daikinmea.com Toll Free: 800-DAIKIN (324546)



DMEA21-214